WO 2004/065869 PCT/AU2003/001623

1/5

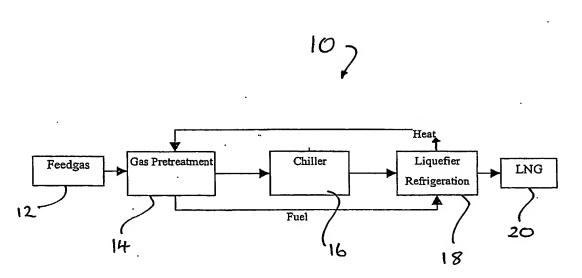


Figure 1

2/5


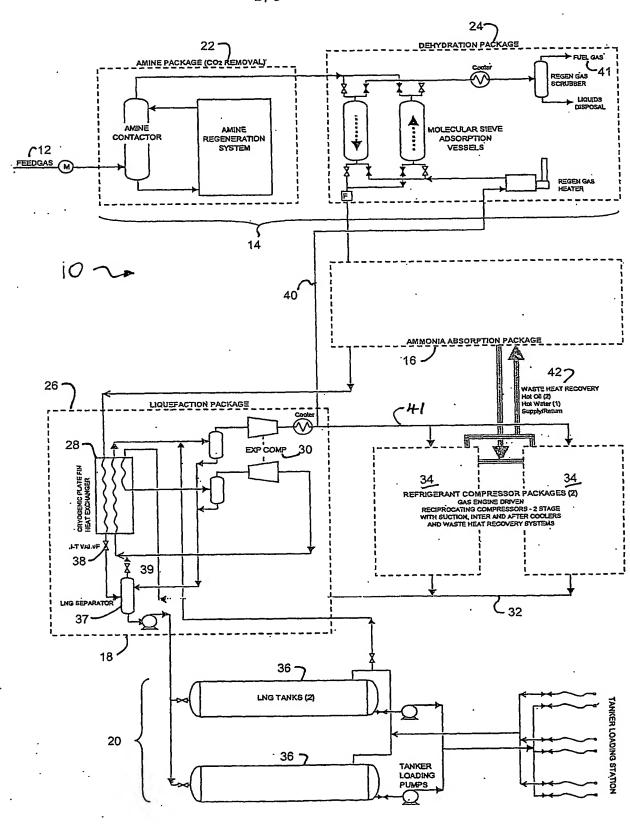


FIGURE 21

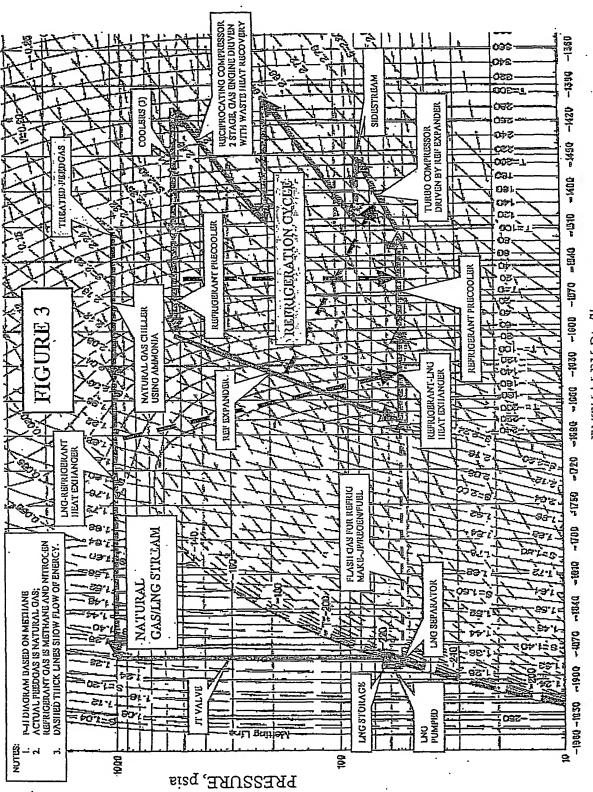

ENTHALPY Btu/lb

4/5

5800 600 1000 1400 1800 2200 2600 3000 3400 3800 4200 4600 5000 5400 Cobling from
Absorption Chiller
using Waste Heat FIGURE 4
Exchanger 2 Heat Curve -2000 200 -110 80-

Delta H MJ/h

Stream 3

WO 2004/065869 PCT/AU2003/001623

5/5

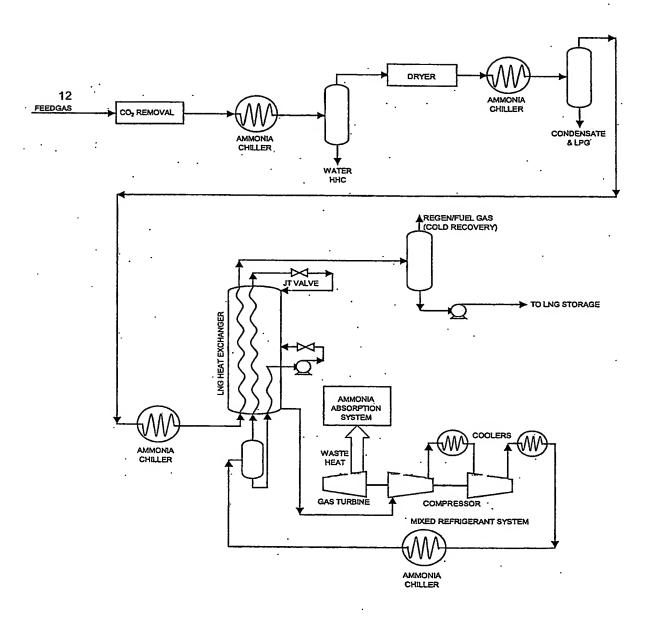


FIGURE 5